


NOTES:

1. $f'_c = 3000\text{psi}$ AT 28 DAYS.
2. STEEL PLATE - ASTM A-36
3. BEARING SURFACE SHALL BE AGAINST UNDISTURBED EARTH.
4. USE SAME DETAIL FOR PLUG.
5. THIS DETAIL SHALL BE USED WHEN THE WATER MAIN HAS TO BE PLACED IN SERVICE IMMEDIATELY AFTER CONSTRUCTION, OR REPAIR. USE STANDARD DETAIL B/1.02 FOR NORMAL CONSTRUCTION.
6. USE A HIGH-EARLY MIX AND ALLOW TO CURE A MINIMUM OF 4 HOURS PRIOR TO BACKFILLING.

L = 2'-9" FOR 6" PIPE
 = 2'-0" FOR 4" PIPE
 = 1'-6" FOR 3" PIPE

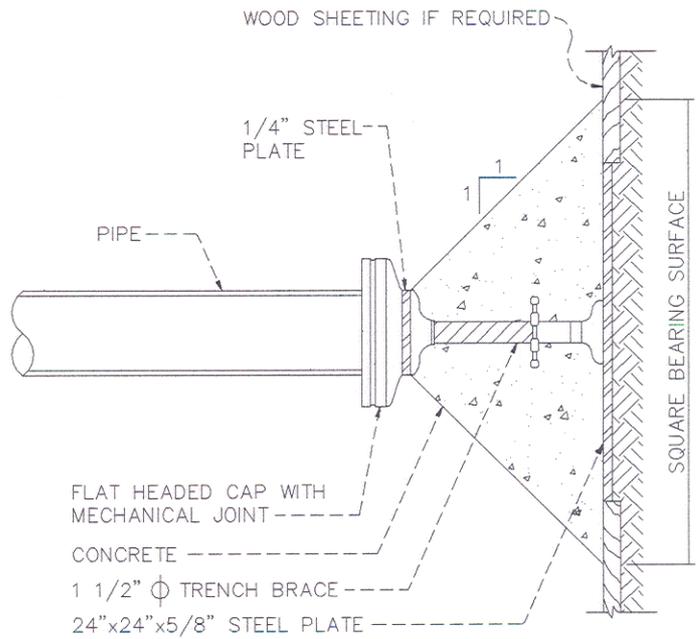

PLAN

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED:

[Signature] 6/29/95
 DIRECTOR OF DEVELOPMENT SERVICES DATE

[Signature] 6/29/95
 WATER / SEWER ENGINEER DATE

STANDARD DETAIL

BLOCKING FOR 3",
 4" AND 6" CAP
 AND PLUG

REVISIONS:

B
 1.04

58*