
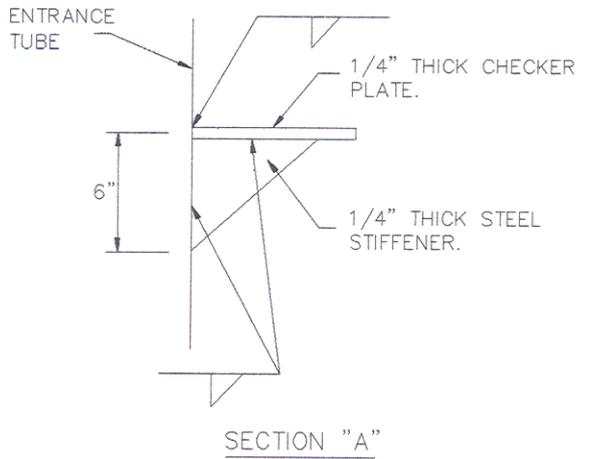
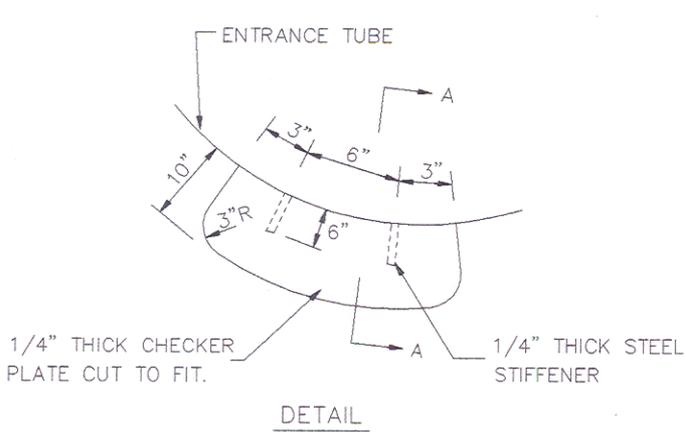


NOTES:

1. ALL STEEL SHALL BE ASTM A-36.
2. WELDS SHALL BE 3/16" WIDE.
3. NO STEP IS REQUIRED, IF ENTRANCE TUBE IS LESS THAN 12" HIGH.
4. ONE STEP IS REQUIRED AT 12" FROM FINISHED GRADE IF ENTRANCE TUBE IS BETWEEN 12" AND 24" HIGH.
5. TWO STEPS ARE REQUIRED AT 12" SPACING FROM FINISHED GRADE, IF ENTRANCE TUBE IS BETWEEN 24" AND 36" HIGH.
6. SPECIAL DESIGN IS REQUIRED FOR STEP, IF ENTRANCE TUBE IS MORE THAN 36" HIGH.
7. PAINT NEW MEMBERS AND WELDED AREA TO MATCH COATING SYSTEM AND COLOR WITH OTHERS.

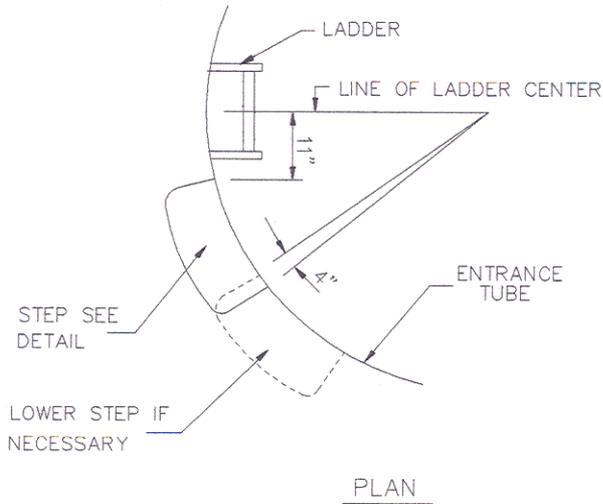

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED:

[Signature] 6/29/95
 DIRECTOR OF DEVELOPMENT SERVICES DATE
[Signature] 6/29/95
 WATER / SEWER ENGINEER DATE

STANDARD DETAIL

DRYWELL ACCESS
 STEP
 (FOR PACKAGE
 PUMPING STATION)

REVISIONS:

M
 3.01

109