


PLAN

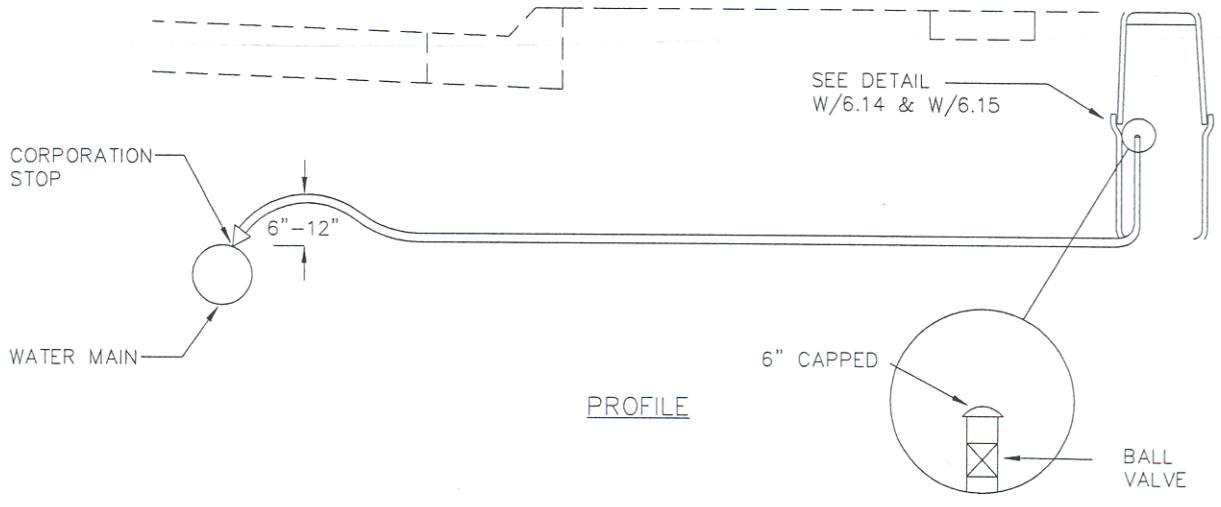

PROFILE

- NOTES:
1. INSTALL W.H.C. LEVEL WITH TOP OF MAIN METER, UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
 2. WHEN W.H.C. AND S.H.C. ARE INSTALLED IN SAME TRENCH, SEE M/2.01.
 3. CORPORATION STOP TO BE LEFT OPEN, BALL VALVE IN METER PIT CLOSED.
 4. METER BOX NOT TO BE LOCATED IN PAVED/TRAFFIC AREAS/SIDEWALK/DRIVEWAY.
 5. SEE DETAIL W/6.14, W/6.15 AND SPECIFICATION SECTION 02553.02.C FOR METER SETTING.

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED: *[Signature]* 1-18-07
CHIEF OF DEVELOPMENT SERVICES DATE

[Signature] 1-18-07
WATER/SEWER ENGINEER DATE

STANDARD DETAIL

INSTALLATION OF
WATER HOUSE CONN-
ECTIONS WITH OUTSIDE
METER

REVISIONS:

JANUARY 2007

MAY 2005

W
2.01