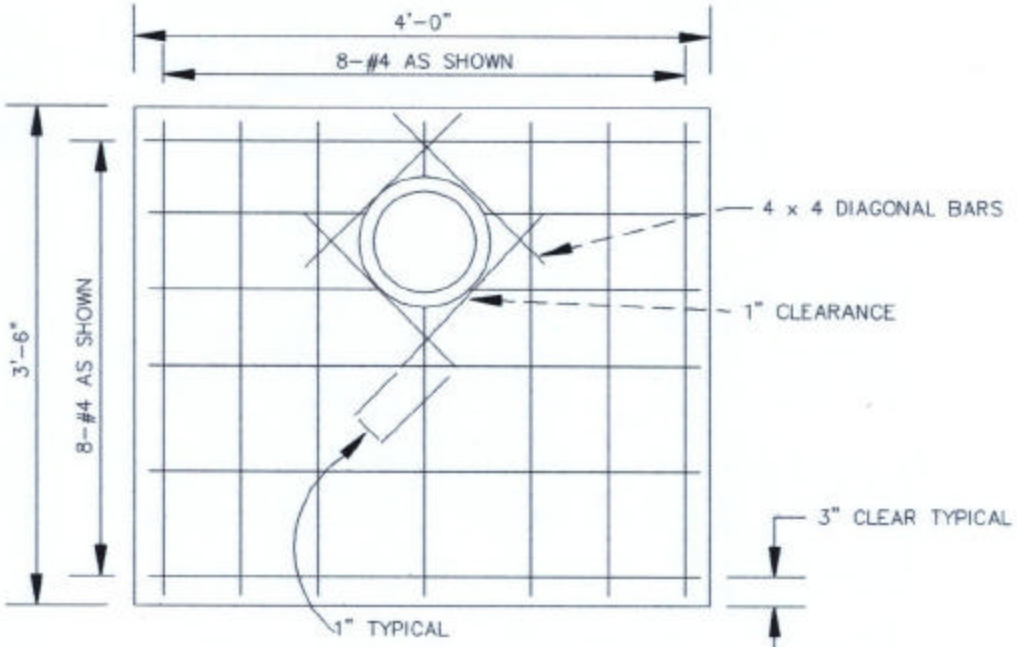

ELEVATION

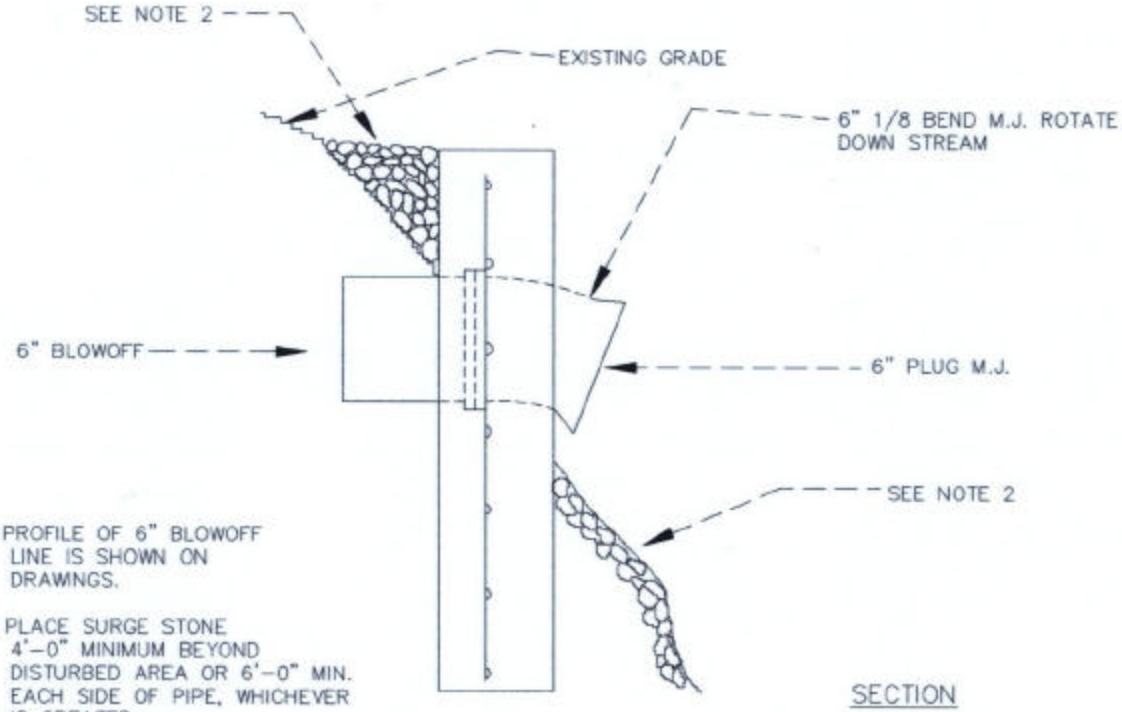

SECTION

1. PROFILE OF 6" BLOWOFF LINE IS SHOWN ON DRAWINGS.
2. PLACE SURGE STONE 4'-0" MINIMUM BEYOND DISTURBED AREA OR 6'-0" MIN. EACH SIDE OF PIPE, WHICHEVER IS GREATER.

CHARLES COUNTY GOVERNMENT DEPARTMENT OF PLANNING & GROWTH MANAGEMENT APPROVED: 6/29/95 DIRECTOR OF DEVELOPMENT SERVICES DATE 6/29/95 WATER / SEWER ENGINEER DATE	STANDARD DETAIL ENDWALL DETAIL FOR TYPE "B" BLOWOFF FOR	REVISIONS:	W 5.05