


NOTES:

- 1 - ELECTRONIC METER READING COVER WITH REMOVABLE PLUG. MANUFACTURER FORD OR COUNTY APPROVED EQUAL.
- 2 - METER SETTING SHOULD NOT BE INSTALLED IN DRIVEWAY OR SIDEWALK.
- 3 - DUAL CHECK VALVE WILL BE INSTALLED AS SPECIFIED UNDER UTILITY PERMIT.

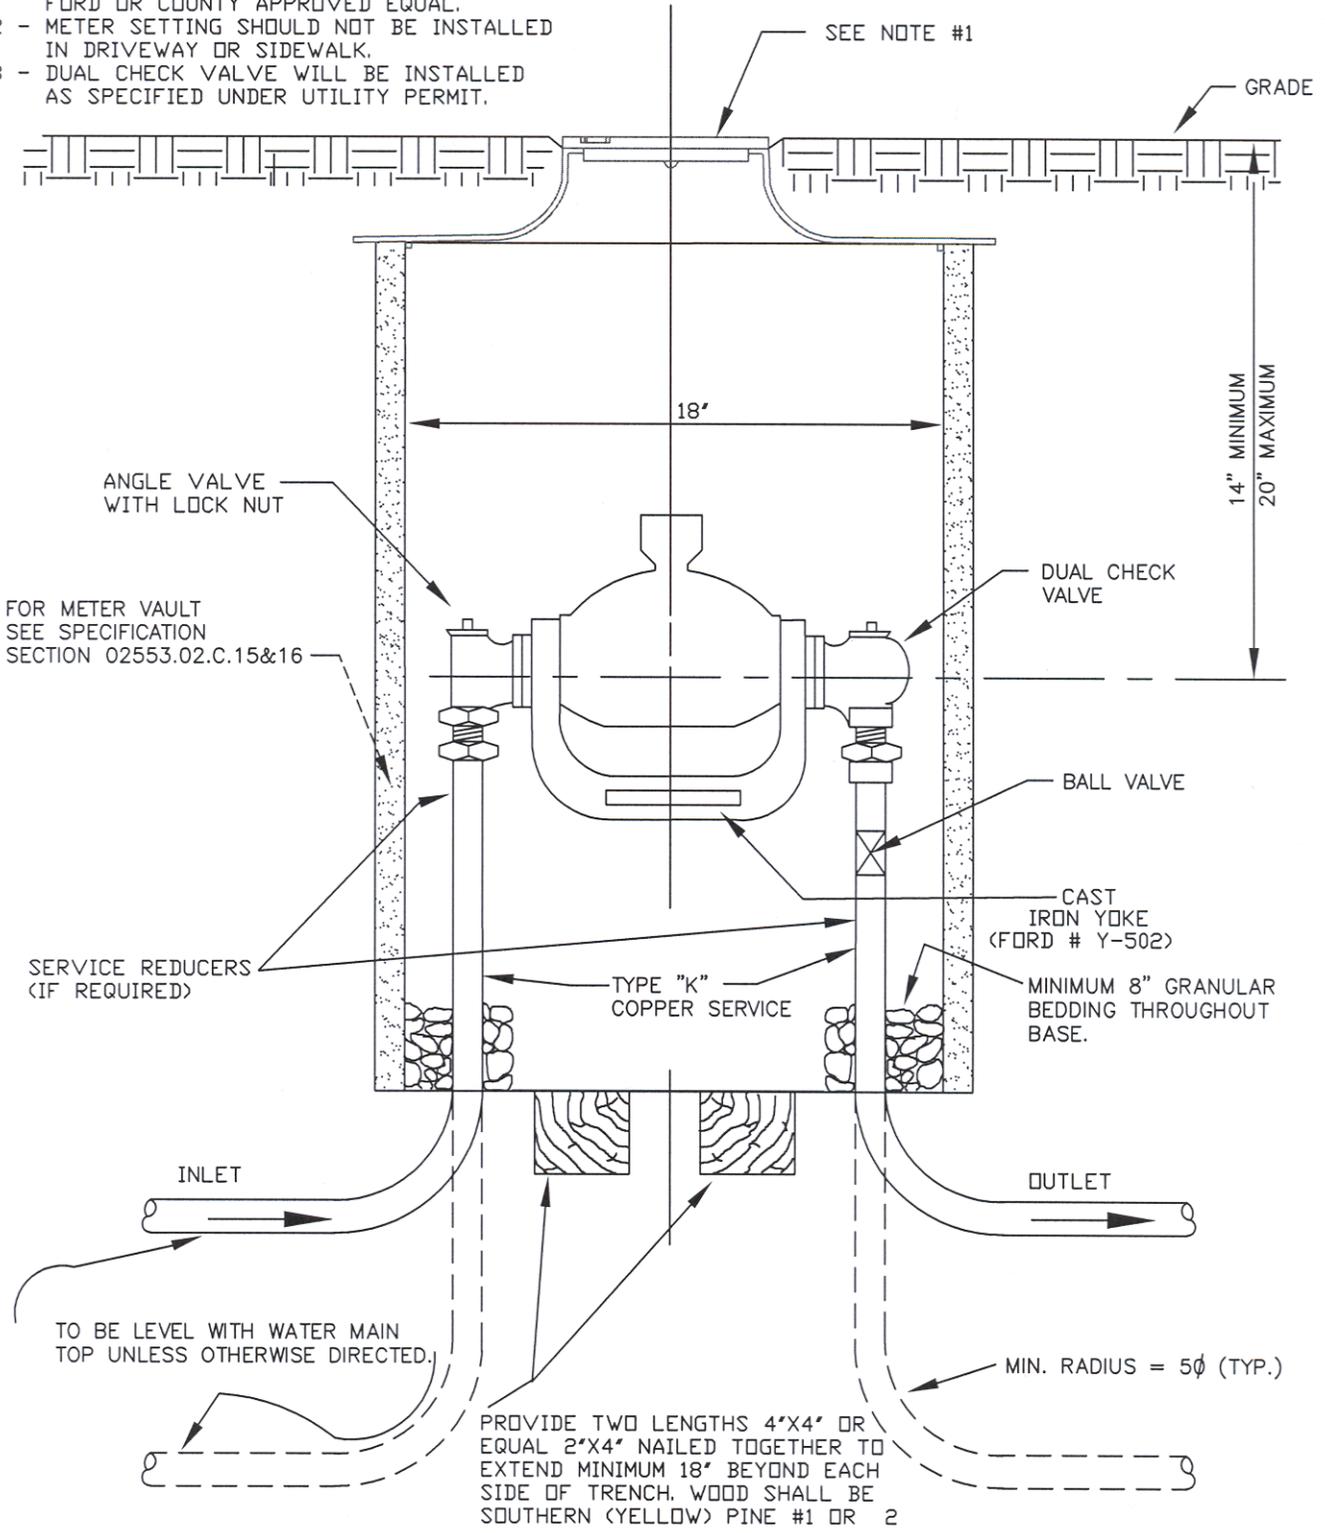

CHARLES COUNTY GOVERNMENT
 DEPARTMENT OF PLANNING & GROWTH MANAGEMENT
 APPROVED: *[Signature]* 3-21-07
CHIEF OF DEVELOPMENT SERVICES DATE
[Signature] 03/21/07
WATER/SEWER ENGINEER DATE

STANDARD DETAIL
 METER SETTING FOR
 5/8", 3/4" & 1" METER
 ON A 1" SERVICE
 (WITHOUT FIRE SPRINKLER SYSTEM)

REVISIONS:
MAY 2005
JAN 2007
MARCH 2007

W
 6.10